



NOTE:

1. BACKFILL SHALL BE INSTALLED AND COMPACTED IN 9" LIFTS
2. CITY ENGINEER MAY REQUIRE GRANULAR EMBEDMENT AS NECESSARY BASED ON LOCAL SOIL CONDITIONS.
3. SELECT FILL SHALL BE USED FOR ALL BACKFILL IF LOCAL SOIL IS CONSIDERED UNSUITABLE

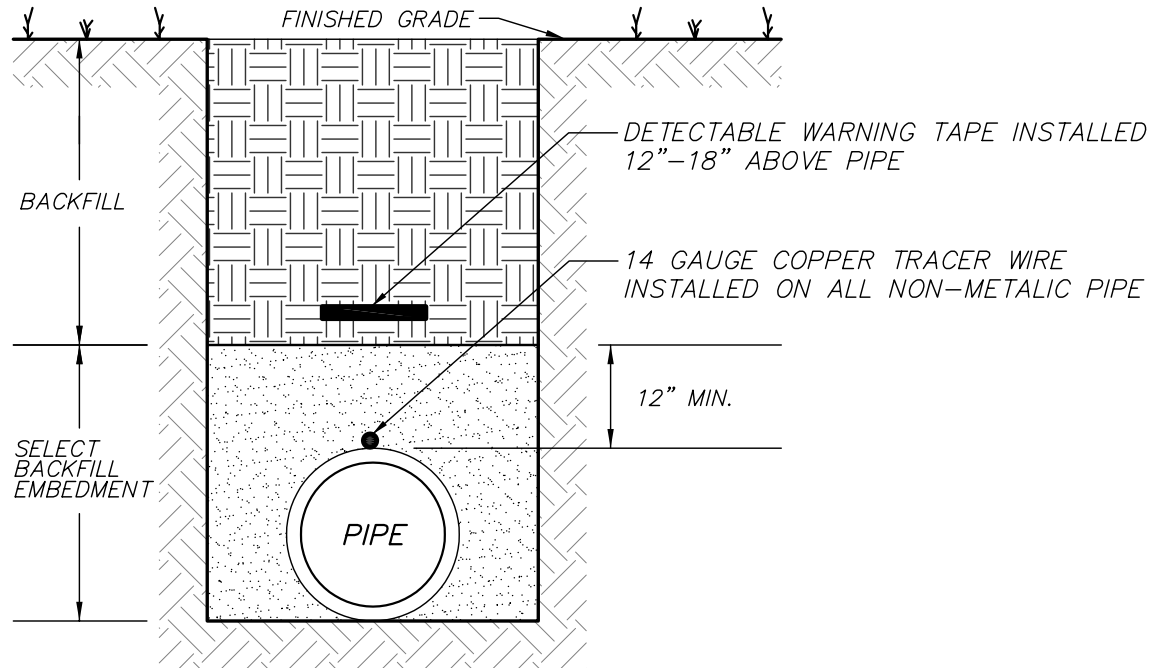

BEDDING FOR WATER AND SEWER FORCE MAINS

NOT TO SCALE

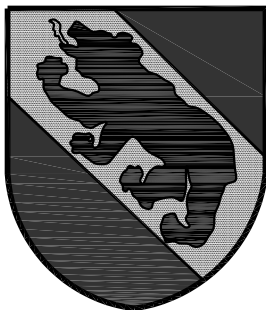

City of New Bern

ENGINEERING DEPARTMENT, PO Box 1129
NEW BERN NC 25263-1129
252.639.7526 (FAX) 252.672.5152
www.newbern-nc.org