


NOTES:

1. ALL CONDUIT TO BE INSTALLED BY ELECTRICIAN AND SHALL BE SCH.40 ELECTRICAL GRADE CONDUITS
2. METER BOX INSTALLED BY ELECTRICIAN
3. MOUNT BOXES 5-6 FT ABOVE FINISHED GRADE
4. CONDUIT SIZES:
 SINGLE PHASE 200A-2" PVC SCH. 40
 SINGLE PHASE 320A-3" PVC SCH. 40
 GANG TYPE METER BOX-4" PVC SCH. 40
 THREE PHASE 200A-3" PVC SCH. 40

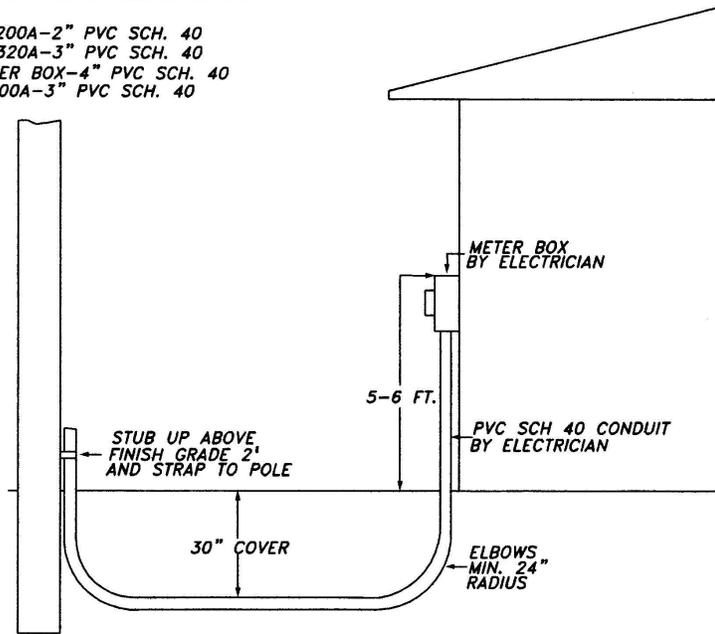

<i>Date</i>	<i>Revisions</i>	<i>Drawn By:</i>	SMALL COMMERCIAL SERVICES	NEW BERN
		<i>Checked:</i>		ELECTRIC
		<i>Approved:</i>		New Bern, N.C.
		<i>Scale: Not to Scale</i>		

Small Commercial Service